

Tamper Proof Manual Control Point (MCP)



Tamper Proof Manual Control Point (MCP)

The Tamper Proof MCP is designed to eliminate nuisance activation of the Smoke Control System whilst delivering the full functionality required of an MCP in accordance with prEN12101-9.

The orange (RAL 2011) MCP displays system and vent status visibly through three LEDs, "power, fault and activated" (all requirements of the prEN standard).


Accreditations




Applications




Technical Drawing

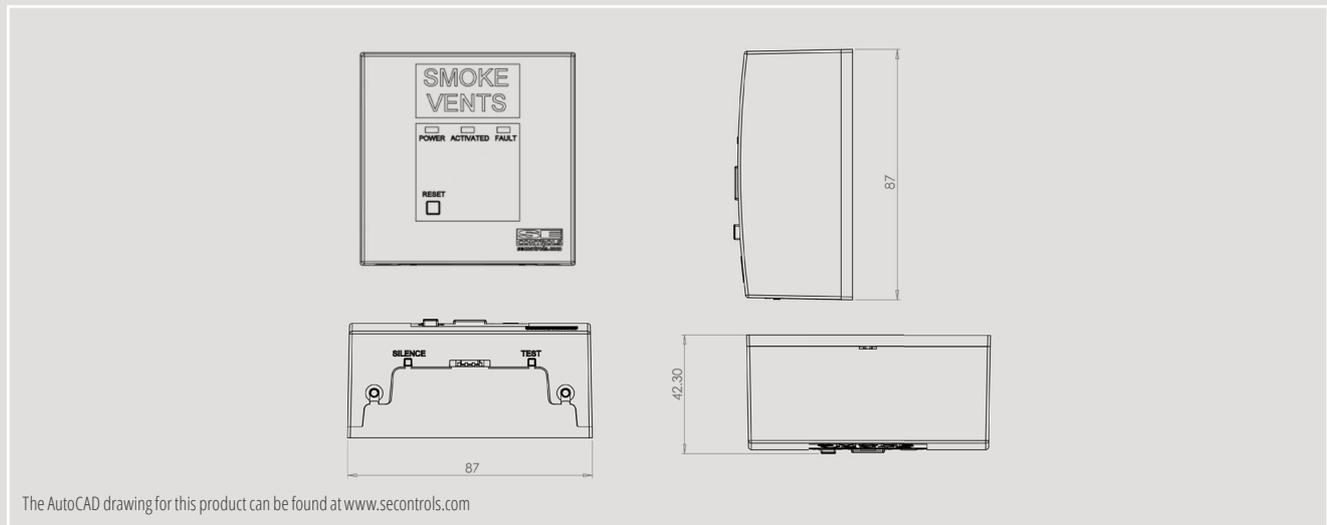

OSLoop Control System

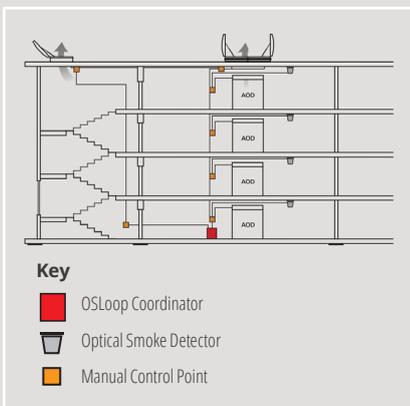

OS2 Control System

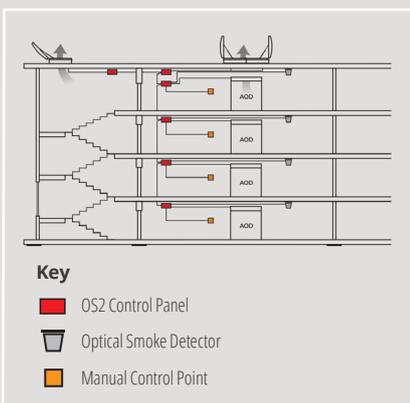

Technical Data

| Device details | |
|--|--|
| | Tested prEN12101-9 |
| | Provided in orange (RAL 2011) as required as part of prEN12101-9 |
| | The device has the capabilities of providing audible signals and faults along with having a silence button out of view |
| | The device continuously monitors actuators and connections to smoke detectors (As required by prEN12101-9) |
| | Event logging to provide historical user information |
| | Maintenance indication (Statutory requirement of the Regulatory Reform Order (Fire Safety)) |
| | Activation via access key fob |
| | Reset via access key fob |
| | Reset push button |
| | Activated LED |
| | Power/Healthy LED |
| | Fault LED |
| For use with 24V OSLoop and OS2 control panels. | 87 x 87 x 22mm (h x w x d) - Flush mount |
| | 87 x 87 x 54mm (h x w x d) - Surface mount |

MCP Part Numbers

| | | |
|--------------------------------|--------------------|-------------|
| OSLoop MCP part numbers | Complete Unit | FCS00300028 |
| | MCP Module | FCS00300020 |
| | Adapter Plate | FCS00300018 |
| OS2 MCP part numbers | Complete Unit | FCS00200081 |
| | MCP Module | FCS00200037 |
| | Adapter Plate | FCS00200017 |
| Accessories | Dumb Reset Key | FCS00200024 |
| | MCP Activation Key | FCS00200033 |
| | Surface Mount Box | FYS15040061 |